


PLAN

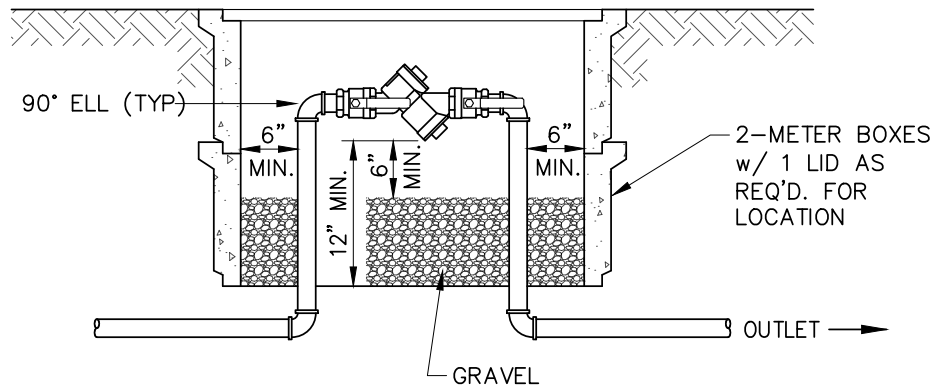

ELEVATION

NOTE FOR FIRE SPRINKLER DCVA'S:
 DCVA SIZE TO BE SPECIFIED BY THE
 FIRE SPRINKLER SYSTEM DESIGNER
 (1" MIN.). PROPOSED VALVE & SIZE
 IS TO BE SUBMITTED TO KCWD NO.
 90 IN WRITING PRIOR TO
 INSTALLATION.

NOTE:

A DOUBLE CHECK VALVE ASSEMBLY (DCVA) IS OWNED AND MAINTAINED BY THE PROPERTY OWNER. THERE IS A STATE MANDATED REQUIREMENT FOR PERIODIC TESTING AND REPORTING TO BE PERFORMED BY THE OWNER, AS AN ONGOING CONDITION FOR WATER SERVICE. DETERMINATION OF DCVA OR RPBA FOR CROSS CONNECTION CONTROL WILL BE MADE BY DISTRICT ON A CASE BY CASE BASIS.



DAVID EVANS
 AND ASSOCIATES INC.

STANDARD DETAIL

DOUBLE CHECK
 VALVE ASSEMBLY



KING COUNTY
 WATER DISTRICT NO. 90

Rev. Date
 11/12/21

DETAIL NO.

21