


PLAN

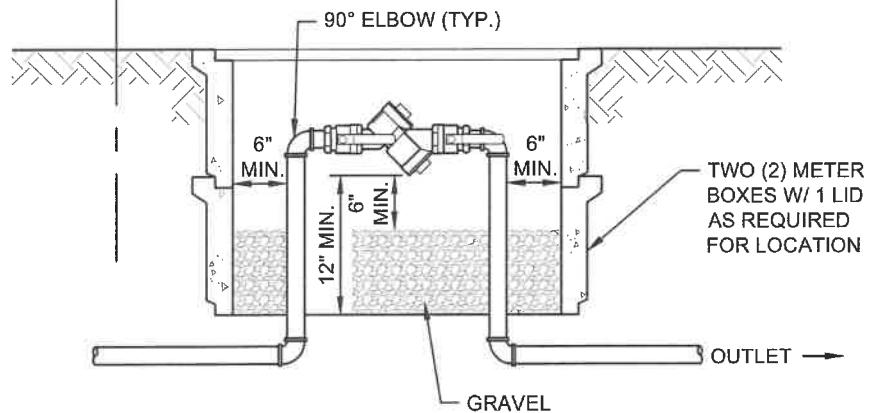

ELEVATION

NOTE:

A DCVA IS OWNED AND MAINTAINED BY THE PROPERTY OWNER. THERE IS A STATE MANDATED REQUIREMENT FOR PERIODIC TESTING AND REPORTING TO BE PERFORMED BY THE OWNER, AS AN ONGOING CONDITION FOR WATER SERVICE. DETERMINATION OF DCVA OR RPBA FOR CROSS CONNECTION CONTROL WILL BE MADE BY THE DISTRICT ON A CASE BY CASE BASIS.

NOTE FOR FIRE SPRINKLER DCVA'S:

DCVA SIZE TO BE SPECIFIED BY THE FIRE SPRINKLER SYSTEM DESIGNER (1" MIN.). PROPOSED VALVE AND SIZE IS TO BE SUBMITTED TO THE DISTRICT IN WRITING PRIOR TO INSTALLATION.



**DAVID EVANS
AND ASSOCIATES INC.**

STANDARD DETAIL

NTS

**DOUBLE CHECK VALVE
ASSEMBLY (DCVA)**



Water District No. 90

Rev. Date
04/2025

DETAIL NO.

21